


steel post. Bolt to support
 three 3/8" SS bolts. Extend
 0" above cabinet. Set PE
 at top of post. Conceal all
 post. Paint to match cabinet.

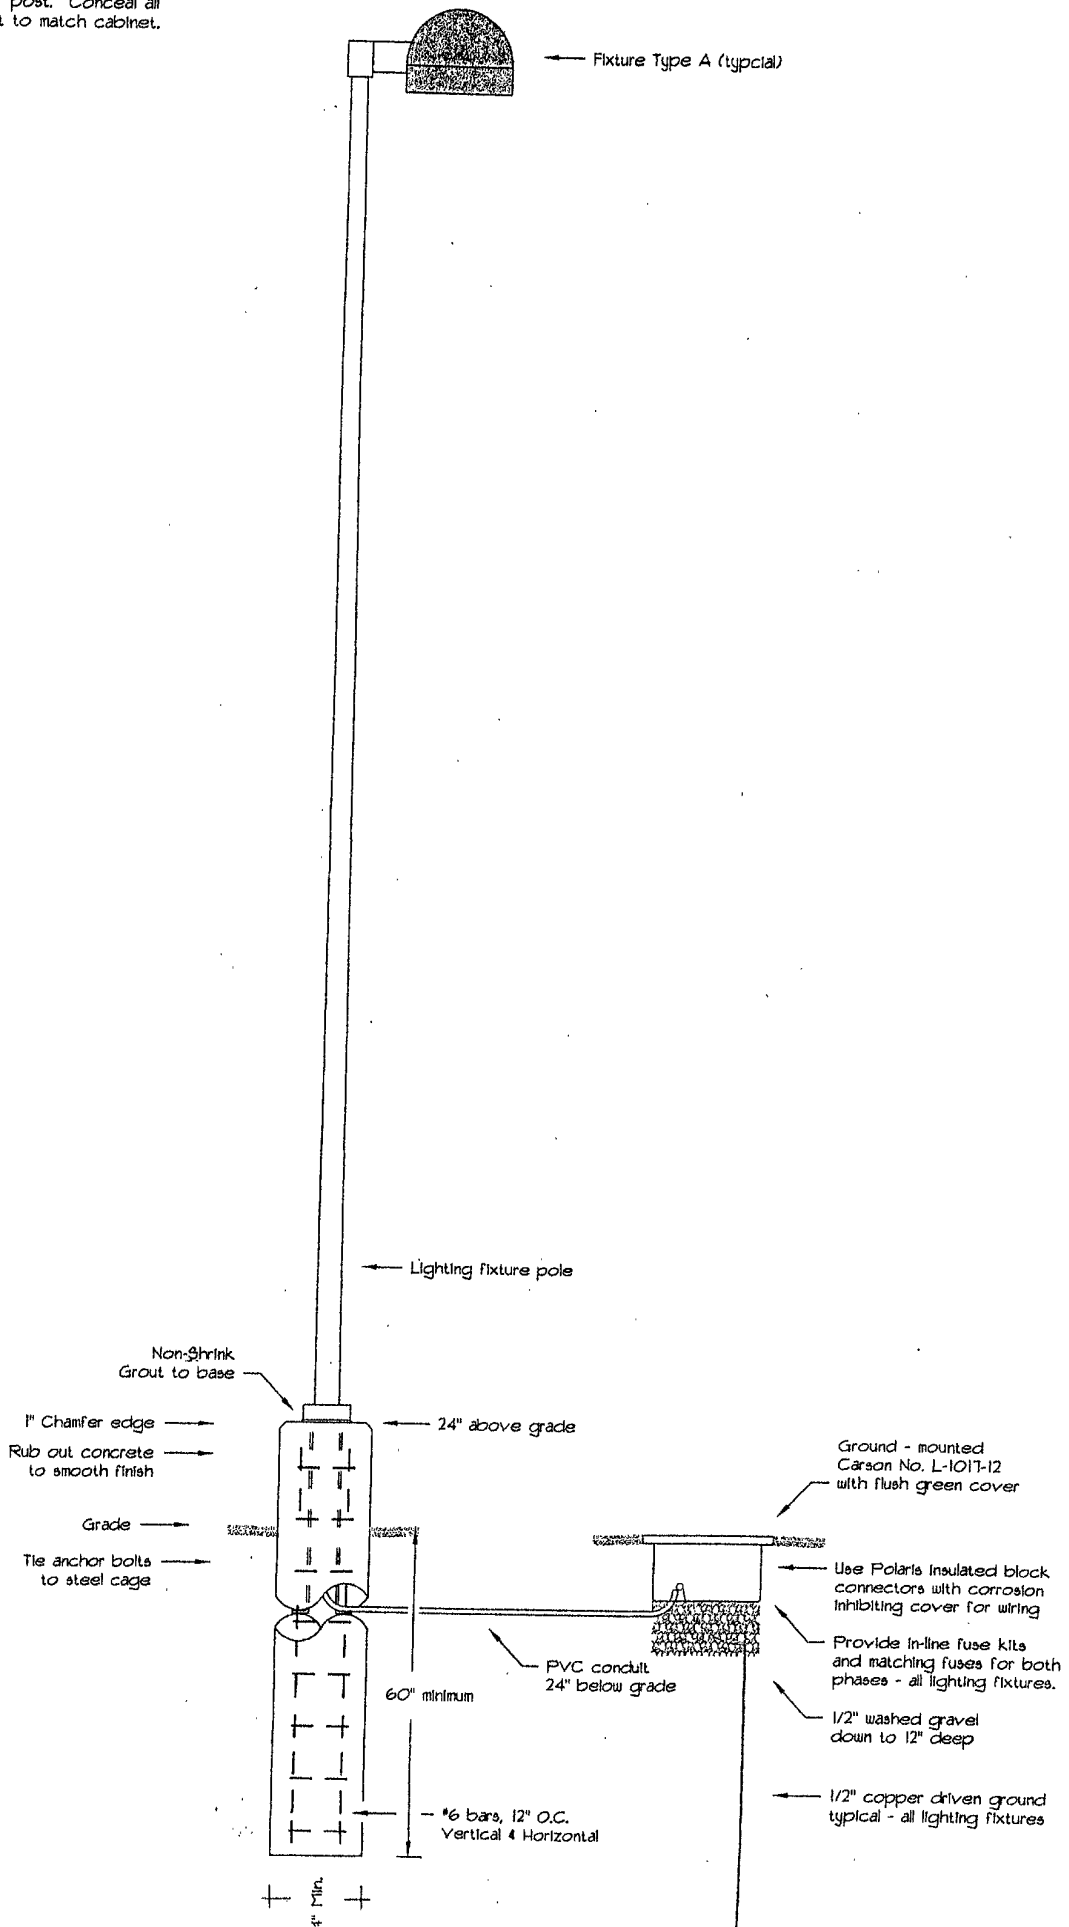

← Fixture Type A (typical)

← Lighting fixture pole

Non-shrink
 Grout to base

1" Chamfer edge

Rub out concrete
 to smooth finish

Grade

Tie anchor bolts
 to steel cage

← 24" above grade

60" minimum

PVC conduit
 24" below grade

← #6 bars, 12" O.C.
 Vertical & Horizontal

4" Min.

Ground - mounted
 Carson No. L-1017-12
 with flush green cover

Use Polaris insulated block
 connectors with corrosion
 inhibiting cover for wiring

Provide in-line fuse kits
 and matching fuses for both
 phases - all lighting fixtures.

1/2" washed gravel
 down to 12" deep

← 1/2" copper driven ground
 typical - all lighting fixtures