



09FV003

409 Deadwood Avenue, PO Box 1400, Rapid City, SD 57709

(605) 721-3200

July 15, 2009

RE: Revised Fence Proposal

Black Hills Power requires a fence that meets all regulatory codes that are intended to protect the public from any hazardous equipment. At the same time, we are aware of our responsibility to do what we can to minimize the visual impact of the substation expansion. Black Hills Power requests the approval of a wrought iron fence similar to those shown in the attachments per the recommendations of City Council members and several of the substation neighbors. The entire outside perimeter of the substation would consist of the wrought iron fence with brick/concrete corner and gate posts. The proposed fence location is attached and shown in bold.

Fence Specifications

Black Hills Power requires, at a minimum, an eight foot tall fence on the outside perimeter of the substation. Additionally it is important that the fence is constructed in such a way to prevent unauthorized people from entering the substation.

Steven Dunn
Black Hills Power
409 Deadwood Ave.
Rapid City, SD 57702
(P) 605-721-2356
(F) 605-721-2323

RECEIVED

JUL 15 2009

**Rapid City Growth
Management Department**

5th Street Substation, Typical Fence Section



8 Feet

10 Feet

07.07.2009

5th Street Substation, Typical Corner/Gate Post




07.07.2009

Cleveland Street
(70' Right-of-Way)
Asphalt

5th Street
(100' Right-of-Way)
Concrete

Alley
(20' Right-of-Way)
Asphalt

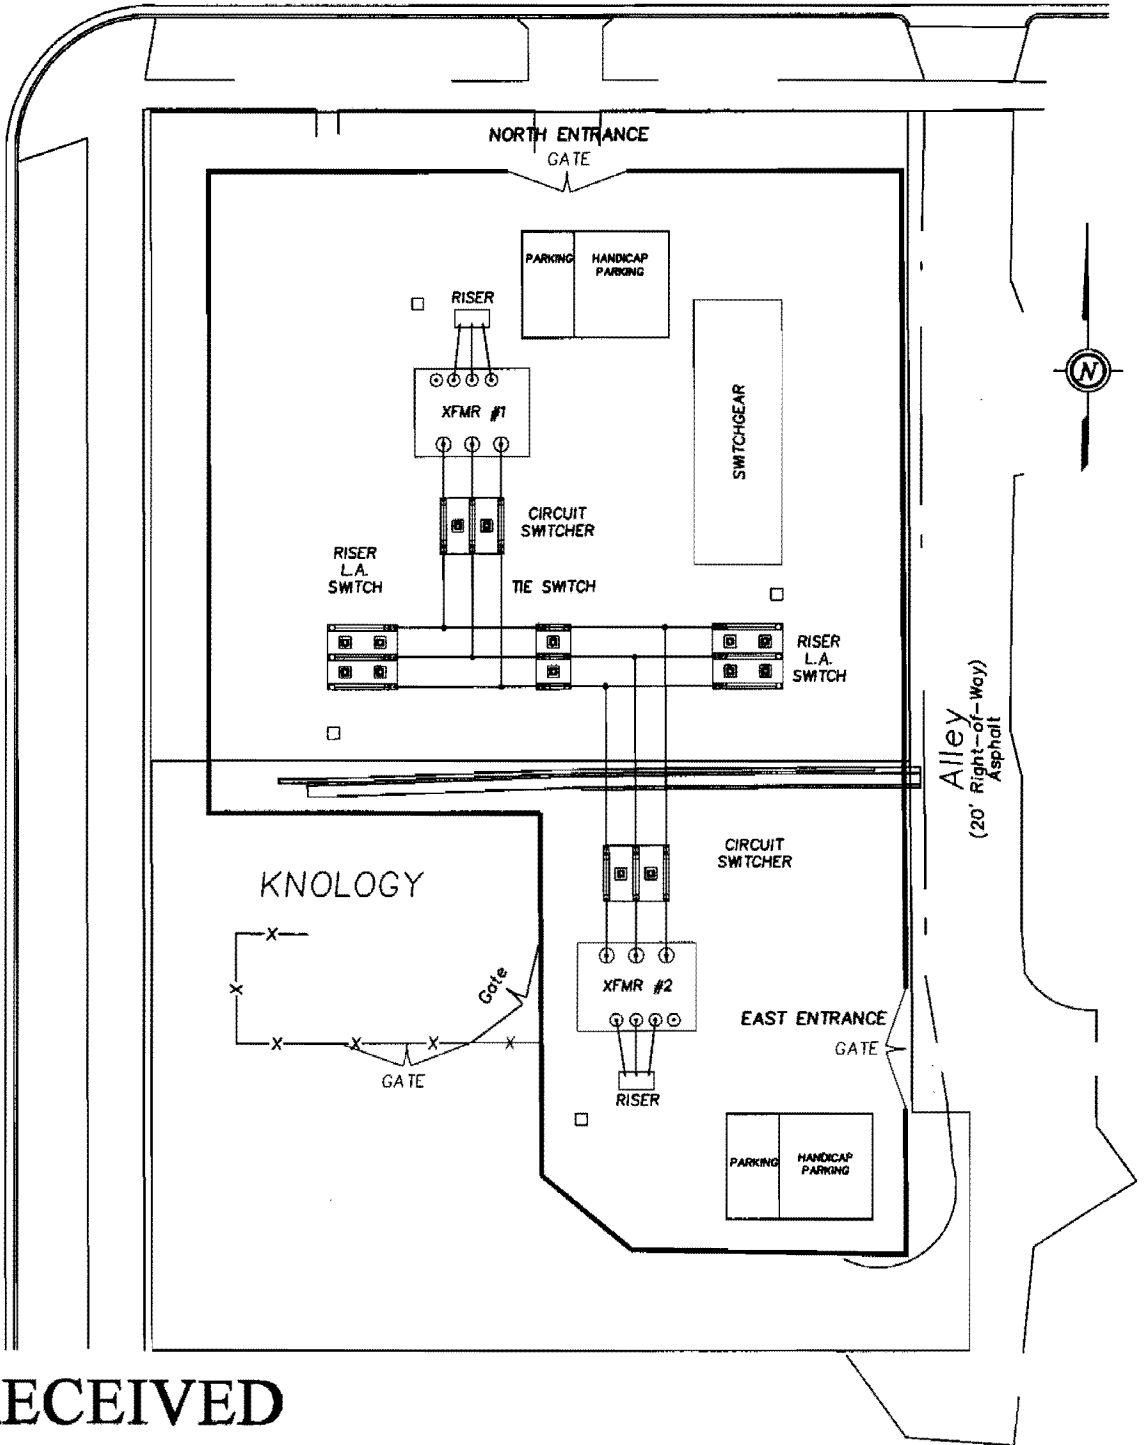

RECEIVED

JUL 15 2009

Rapid City Growth
Management Department

NO.	DATE	BY	NO.	DESCRIPTION

BLACK HILLS POWER
FIFTH STREET SUBSTATION
GENERAL ARRANGEMENT

DATE: 03/25/09
BY: J.E.
NO. XX

FIF-C-001