




Cleveland Street

Fifth Street

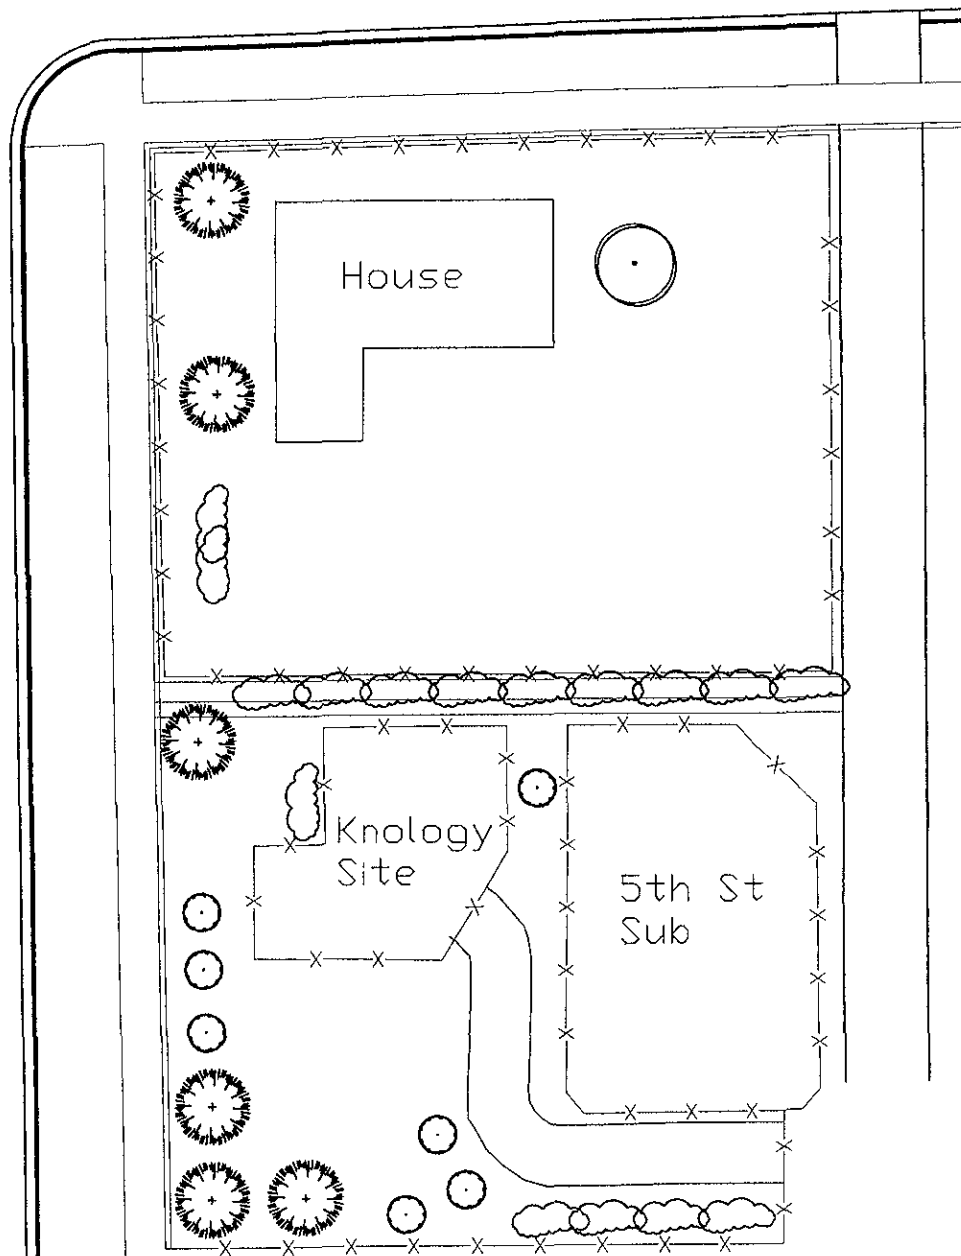

General layout of Existing Substation



Cleveland Street
 (70' Right-of-Way)
 Asphalt

5th Street
 (100' Right-of-Way)
 Concrete

Alley
 (20' Right-of-Way)
 Asphalt

60KV UNDERGROUND

60KV UNDERGROUND

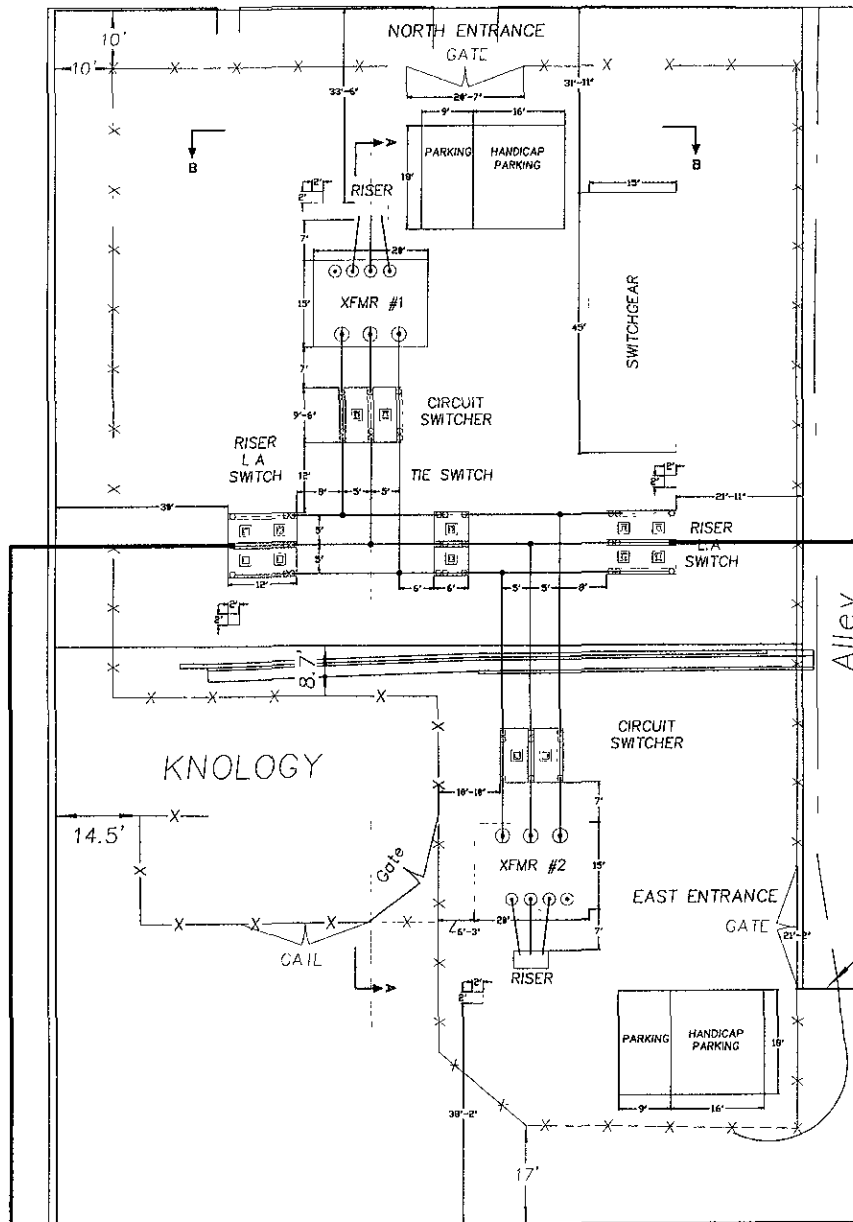

DATE	BY	NO.	APP'D	REVISION DESCRIPTION


BLACK HILLS POWER

FIFTH STREET SUBSTATION

GENERAL ARRANGEMENT

DATE: 03/25/09
 S.D. NO. XX

FF-C-001

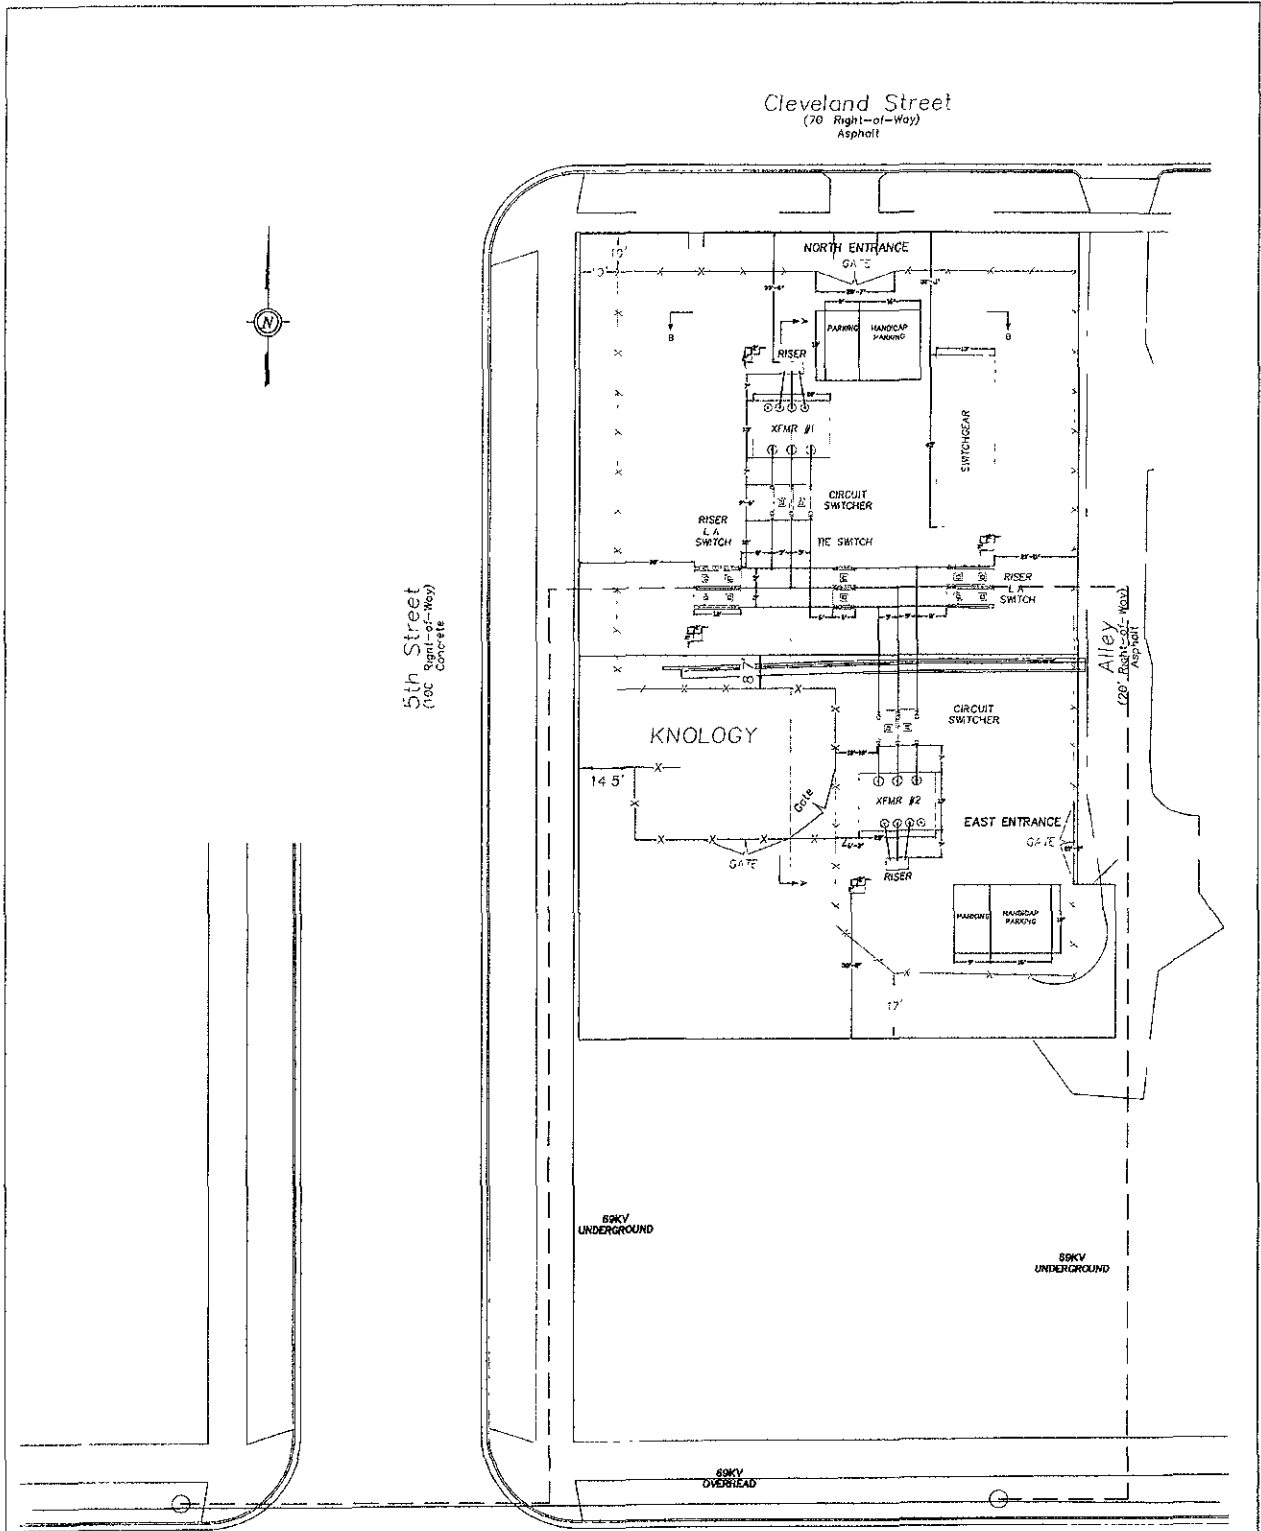


EXISTING 69kV POLE
 Replace with 69kV riser structure

Remove 69kV overhead between existing structures

Oakland Street

EXISTING 69kV POLE
 Replace with 69kV riser structure



BLACK HILLS POWER & LIGHT					FIFTH STREET SUBSTATION	
GENERAL ARRANGEMENT					69kV Underground Transmission Plan	
DATE	BY	NO.	APP'D BY	REVISION DESCRIPTION	DATE	BY

DATE: 03/25/19
 DRAWN BY: [Signature]
 CHECKED BY: [Signature]
FIF-C-001