
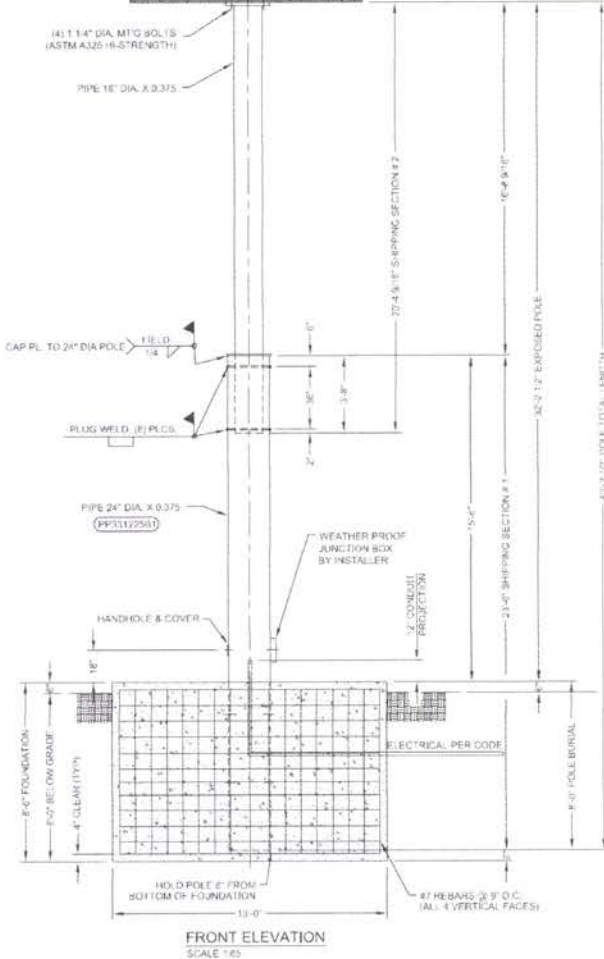
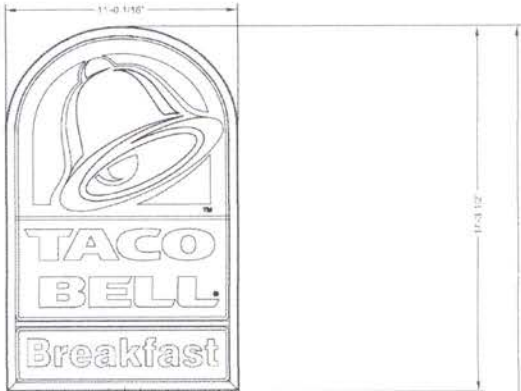


This drawing is for example purposes only and is not for construction. Each location will require a site specific drawing.

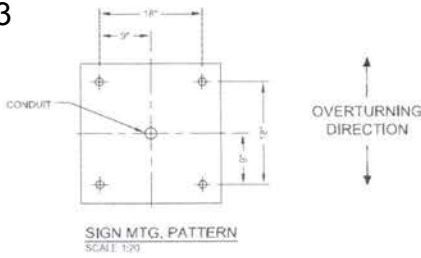

45'-0"

GENERAL NOTES

INSTALLER TO PROVIDE COMPLETION PHOTOS OF

FOUNDATION WITH ANCHOR BOLTS, REBAR & CONDUIT (BEFORE & AFTER POUR).
BASE PLATE(S) = ANCHOR BOLT CONNECTIONS. GROUT INSTALLATION. MATCH
PLATE SIGN CONNECTIONS, ANY WELDED CONNECTIONS, ELECTRICAL WIRING AND
OVERALL ELEVATION.

THIS SIGN IS INTENDED TO BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS
OF ARTICLE 600 OF THE NATIONAL ELECTRIC CODE AND/OR OTHER APPLICABLE
LOCAL CODES. THIS INCLUDES PROPER GROUNDING AND BONDING OF THE SIGN.

LANDSCAPING MATERIALS SHOULD BE KEPT MINIMUM TWO INCHES AWAY FROM SIGN
POLES (CHASSIS PLATES).

CONCRETE SPECIFICATION

24 M3 CU. YDS. TOTAL. CONCRETE SHALL HAVE A MIN. COMPRESSIVE STRENGTH OF
3,000 PSI @ 28 DAYS. REINFORCING STEEL SHALL HAVE A MIN. YIELD STRENGTH OF
60,000 PSI. RECOMMENDED MIN. CURE TIME OF 7 DAYS BEFORE PROCEEDING WITH
INSTALLATION.

LIFTING HOLE NOTE

ANY LIFTING HOLES CREATED ARE THE RESPONSIBILITY OF THE INSTALLER. LIFTING
HOLES ARE TO BE SEALED BY A CAP PLATE, WELDED OVER TO COVER AND THEN
PAINTED.

WELDING NOTE

ANY REQUIRED WELDING IS TO BE COMPLETED BY AN AWS CERTIFIED WELDER
QUALIFIED IN THE APPLICABLE POSITIONS NEEDED.

DESIGN NOTE

SIGN POLE AND CONCRETE FOUNDATION ARE DESIGNED TO WITHSTAND A WIND
LOAD OF 25 PSF.

CONCRETE BASE DESIGNED USING A LATERAL SOIL BEARING CAPACITY OF 150 PSF /
FT. IF THESE SUB. CONDITIONS DO NOT EXIST AT THE FOUNDATION
LOCATION, IT IS THE ERECTOR'S RESPONSIBILITY TO NOTIFY EVERBRITE, LLC PRIOR
TO PERFORMING ADDITIONAL EXCAVATION OR ANY CONCRETE PLACEMENT.

INSTALLATION INSTRUCTIONS

1. STAKE FOUNDATION AREA AND CONFIRM FINAL GRADE REQUIREMENTS WITH O.C.
2. EXCAVATE FOUNDATION AREA.
3. SET ANCHOR BOLTS, REBAR AND CONDUIT STUB. (PRIMARY ELECTRICAL SERVICE
TO BASE BY O.C.)
4. POUR CONCRETE AND ALLOW PROPER CONCRETE CURE TIME AS REQUIRED
5. SET COLUMN PLUMB AND ANCHOR COLUMN AS SHOWN IN ALL DETAIL.
6. MOUNT SIGNS TO POLE.
7. MAKE FINAL ELECTRICAL/HOOK UP. (ALL ELECTRICAL TO MEET LOCAL CODES.)
8. TEST LIGHT SIGN AND TOUCH UP SIGN DRUM AS NEEDED.
9. REMOVE LIFTING BRACKETS AND REINSTALL BOLTS
10. CLEAN UP AREA AND REMOVE ANY PACKING MATERIAL.

EVERBRITE TO FINISH

1. 179 SQ. FT. SIGN
2. MOUNTING POLE IN TWO PIECES
3. TOUCH UP PAINT

INSTALLER TO FINISH

1. ALL ELECTRICAL COMPONENTS REQ'D
2. FOUNDATION

INSTALLER TO BE SURE SIGNS ARE PROPERLY INSTALLED, CONNECTED AND
GROUNDED.

GENERAL CONTRACTOR TO FINISH


PRIMARY WIRES FROM BUILDING TO SIGN

SIGN SPECIFICATIONS

TOTAL LOAD = 36 ASTMS, 120 VOLTS (3) 20 AMP
LUMENS = 20,000 10'x14'
LUMENS / SQ. FT. = 546.6 SQ
AREA OF SIGN = 177.9 SQ. FT.

POLE SPECS

WELDED POLE LENGTH: 40'
EXPOSED POLE LENGTH: 16'-8 3/16"
TOTAL POLE LENGTH: 45'-2 1/2"
SHIPPING SECTION #1 WEIGHT: 2067 LBS
SHIPPING SECTION #2 WEIGHT: 1656 LBS
APPROX. TOTAL POLE WEIGHT: 4179 LBS

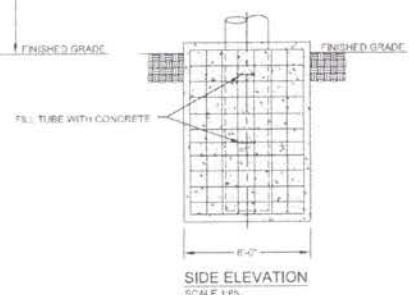

| INSTALLATION DRAWING | | | | SITE | |
|----------------------|--|------|-------------------------------------|----------------|--------|
| DRAWN BY | | DATE | | SCALE AS SHOWN | |
| CHK BY | | DATE | | REP | |
| PROJECT NO. | | | DWG NO. | | REV. A |
| DWG TITLE | | | 179 SQ. FT. TACO BELL @ -50'-0" OAH | | |



THESE DRAWINGS ARE THE EXCLUSIVE PROPERTY OF EVERBRITE, LLC. USE OF, OR DUPLICATION IN ANY MANNER WITHOUT EXPRESS WRITTEN PERMISSION OF EVERBRITE, INC., IS PROHIBITED.

45'-0"